

**LOW POWER VERSION**  
**DUAL HYDROCARBONS AND CARBON DIOXIDE 'BIOGAS' SENSOR**  
**Exd Certified VERSIONS**

**\*\*\* Available in EN50271 / SIL1 Certified versions \*\*\***

**SIL1**  
**SIL1**



**MSH2-LS/HC/HCO2**  
**MSH2ia-LS/HC/HCO2**

**Non - SIL**  
**Non - SIL**



**MSH2-LD/HC/HCO2**  
**MSH2ia-LD/HC/HCO2**

- **Use 80% less power than the other product ranges, whilst delivering two independent gas sensor channels**
- **Equivalent current per sensor channel of only 7.5mA**
- **Drop-in replacement**
- **No loss of performance**
- **Uses the same well-established technology**

## FEATURES

- ★ **Combines all the features of the Hydrocarbon and Carbon Dioxide Premier sensors, enabling the measurement of two different gases with one sensor.**
- ★ **No increase in physical size or power consumption when compared with a single gas Premier sensor. Ideal for portable, battery powered instruments.**
- ★ **Contains all the necessary optics, electronics and firmware to provide TWO linearised, temperature-compensated measurements: Methane and Carbon dioxide**
- ★ **Digital output for direct interface to host circuitry.**
- ★ **The hydrocarbon and carbon dioxide channels can be used to measure methane from 0 to 100% volume.**
- ★ **Specifically designed for applications with high concentrations of methane and carbon dioxide simultaneously.**
- ★ **Fast track route for original equipment manufacturers to introduce the latest infrared technology – without any specialist knowledge.**
- ★ **Internal Flash memory allowing sensor firmware updates via configuration equipment.**

## Dynamant Limited

Hermitage Lane Industrial Estate • Kings Mill Way • Mansfield • Nottinghamshire • NG18 5ER • UK.

Tel: 44 (0)1623 663636 •

email: [sales@dynamant.com](mailto:sales@dynamant.com) • [www.dynamant.com](http://www.dynamant.com)

## DESCRIPTION

Dynamant infrared sensors operate by using the NDIR principle to monitor the presence of target gas. The sensor contains a long-life tungsten filament infrared light source, an optical cavity into which gas diffuses, temperature compensated pyroelectric infrared detectors, an integral semiconductor temperature sensor and electronics to process the signals from the pyroelectric detector.

The sensor uses a digital output for direct communications with instrument electronics. The digital output is a UART format comprising 8 data bits, 1 stop bit and no parity. Refer to specification for available baud rates.

## Patent Protection

**The sensor design is protected by the following Patents**



<b>Great Britain</b>	<b>GB 2 401 432 &amp; GB 2 403 291</b>
<b>Europe</b>	<b>EP 1544603 &amp; EP 1818667-Pending</b>
<b>France</b>	<b>EP [ FR ] 1544603</b>
<b>Germany</b>	<b>EP [ DE ] 1544603</b>
<b>Italy</b>	<b>EP [ I ] 1544603</b>
<b>Switzerland</b>	<b>EP [ CH ] 1544603</b>
<b>USA</b>	<b>7, 244, 939</b>
<b>Other World Patents</b>	<b>Pending</b>

## Hydrocarbon Response Characteristics

The Premier range of hydrocarbon infrared gas sensors are calibrated to provide an output signal linearised for a specific gas type and concentration during manufacture.

However, the sensor will also respond to a range of other hydrocarbon gases. The following graphs show the relative response of a methane sensor, and a propane sensor, to some of the common hydrocarbons.

These characteristics can be used as a guide to setting-up the associated instrument alarm levels.

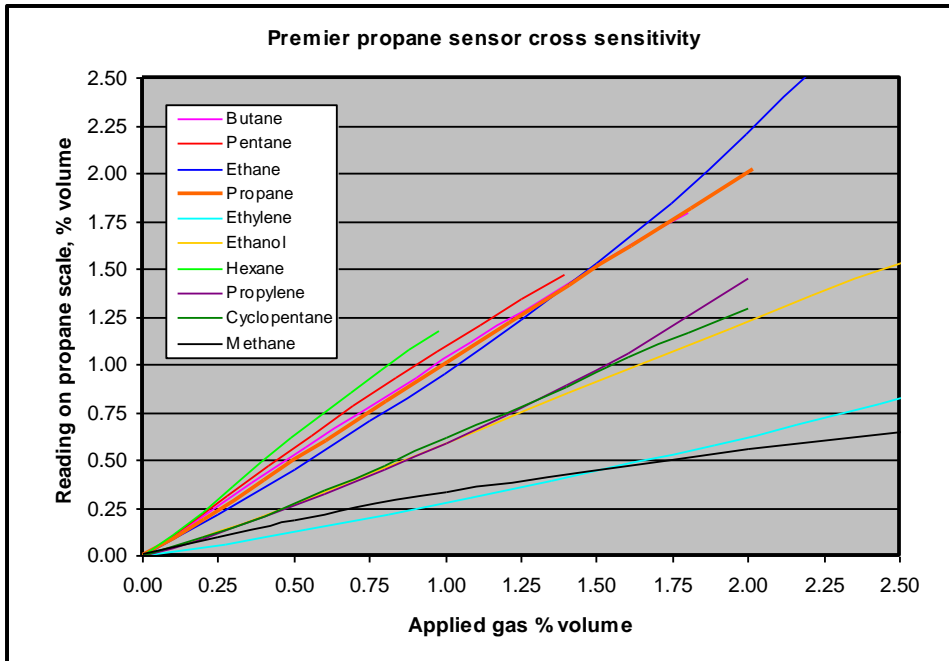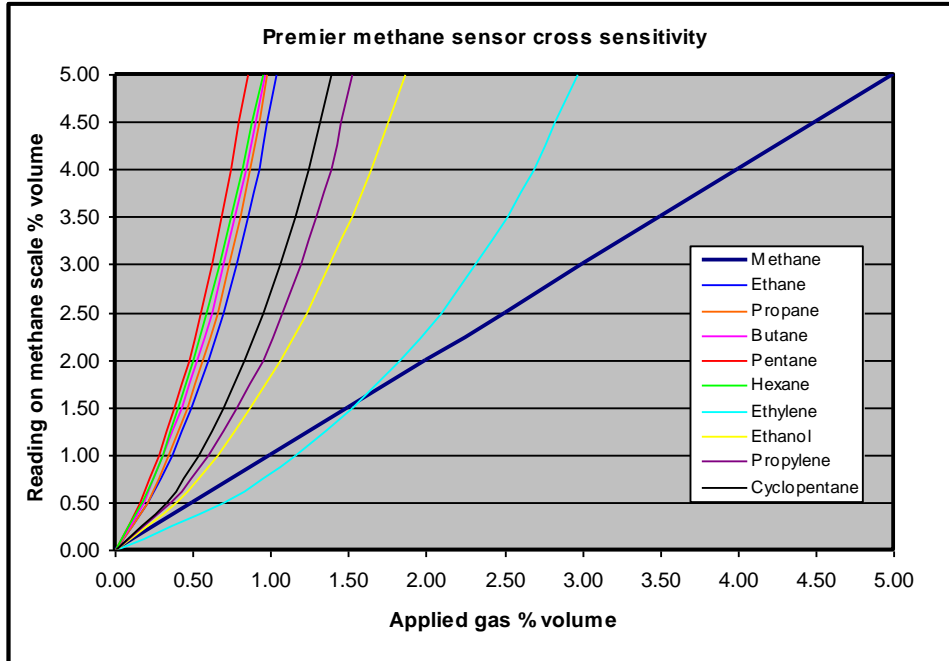


Note – Refer to data sheet TDS0050 for additional cross reference data

## Hydrocarbon Temperature Compensation

The Premier sensor is temperature compensated over the range of -20°C to +50°C. The output variation is  $\pm 2\%$  FSD or  $\pm 10\%$  of the reading up to 50% FSD and  $\pm 15\%$  of the reading from 50% to 100% FSD, whichever is greater.


The following graph is based on the hydrocarbon sensor being characterised for methane.

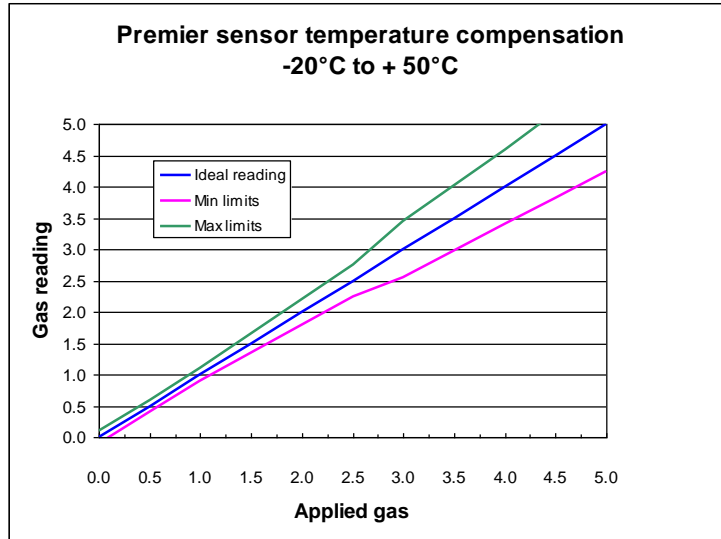

## Hydrocarbon Linearity


The Premier sensor linearity at ambient temperature is  $\pm 10\%$  of the applied gas, or  $\pm 0.05\%$  volume, whichever is greater.

The following graph is based on the hydrocarbon sensor being characterised for methane, data based on 24 sensors.

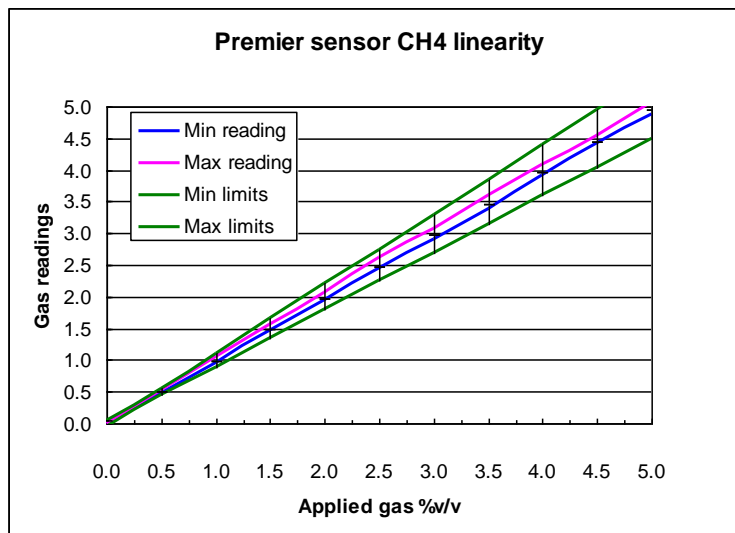

## Carbon dioxide Temperature Compensation


The Premier sensor is temperature compensated over the range of -20°C to +50°C. The output variation is  $\pm 0.1\%$  v/v or  $\pm 10\%$  of the applied gas up to 50% FSD and  $\pm 15\%$  of the applied gas from 50% to 100% FSD, whichever is greater.

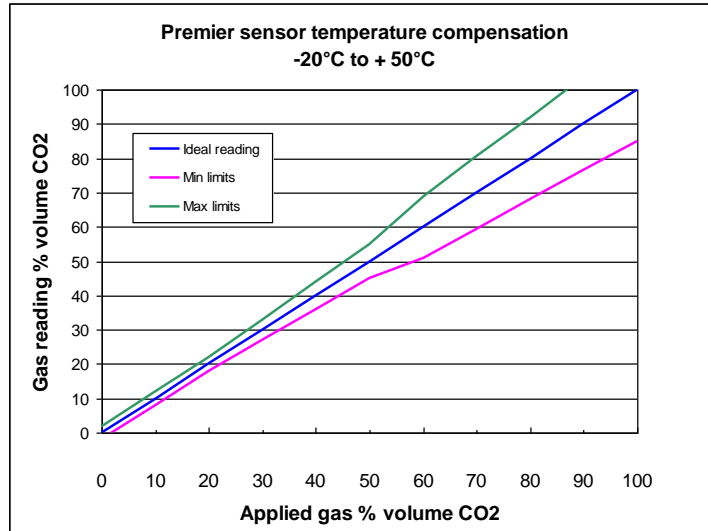

## Carbon dioxide Linearity

The Premier sensor linearity at ambient temperature is  $\pm 3\%$  full scale or  $\pm 10\%$  of the applied gas up to 80% full scale and  $\pm 15\%$  of the applied gas from 80% to 100% full scale, whichever is greater.

The following graph is based on the 0-100% v/v sensor, data for 24 sensors.

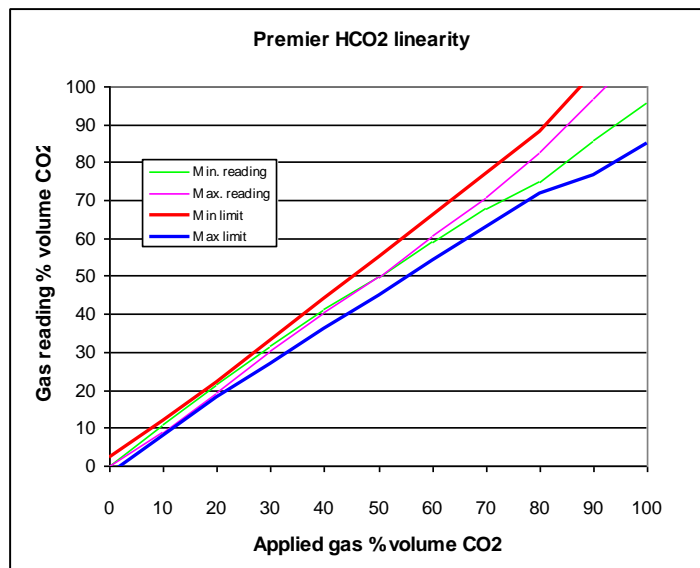

## Calibration options

Dynamant recommend a maximum interval of 12 months between calibration checks. A small amount of zero drift can be accommodated by re-zeroing the gas detector against the sensor. The degree of drift that is acceptable should be determined by the user. Note that the subsequent change in gas reading will be greater than the change in zero reading.

The Dual Gas sensor has four ranges in all.

Range 1	0-5% volume methane
Range 2	0-100% volume methane
Range 3	0-2% volume propane
Range 4	0-100% volume carbon dioxide

If the sensor requires either a “Zero” or “Span” adjustment, there are two methods that can be used:

1) By using the “Premier Configuration Unit”

When used in conjunction with dedicated PC software, this device uses the data communication pins on the sensor to provide a means of calibration.

2) By using the data communications pins and software written in accordance with the protocol supplied by Dynamant.

Gas calibration is best carried out at 100% of the full scale for ranges 2 & 4 and at 50% of the full scale for ranges 1 & 3. Other calibration levels, between 10% and 100% of the range can be used but may affect the accuracy of the readings.

If the calibration gas level is entered incorrectly there will be an error in the calibration. It is the user’s responsibility to ensure that the calibration procedure is correctly applied. Checks on the correct calibration gas level that are used during span operations should be implemented within the calibration routine of the host gas detector’s firmware.

In all cases ensure that the sensor has been powered long enough for the temperature to have stabilised before starting the calibration. This time will vary in accordance with the way in which the sensor is mounted.

**Note:** a zero calibration must always be carried out before a span calibration.

**CALIBRATE EACH GAS TYPE INDIVIDUALLY – DO NOT USE A MIXTURE OF CH<sub>4</sub> AND CO<sub>2</sub> IN THE SAME CYLINDER. DOING SO WILL RESULT IN AN INCORRECT CALIBRATION.**

## Sensor warm-up time

### Digital output behaviour:

When power is first applied to the sensor, the digital output is held at -250% of the full scale for the duration of the “warm-up” time.

**Note:** The duration of the “warm-up” time can be pre-programmed to alternative values at the time of ordering sensors and later configured via the configuration unit.

## Temperature transients and gas flow rates.


The Premier sensor employs a pyroelectric detector, the output from which can be disrupted by sudden changes in temperature. If there is an excessive change in the ambient temperature, gas sample temperature or flow rate, then the output signal will be momentarily frozen. Correct operation is restored when the effects of the transient have settled. Rates of change in the ambient temperature should be restricted to 2°C/minute and gas flow rates kept below 600 cc/minute.

## Power supply considerations

The sensor power supply rise time must be less than 50 mS to ensure correct operation. Operation outside the range of 3 – 5 V dc will result in either fault indication, or the sensor will not function correctly.

The current consumption varies during the program cycle at a rate of 2Hz. The peak current is 36mA, the current whilst the infrared source is powered is 20mA and the current whilst the source is turned off is 7mA.

The average current with a 3V power supply is 15mA.

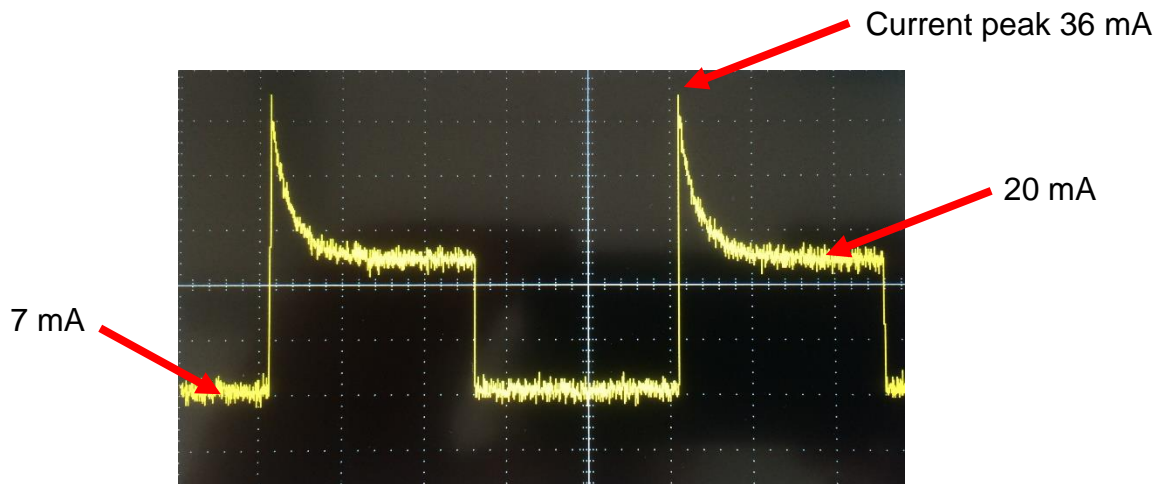

Current waveform for Premier low power sensor.

## Sensor over-range condition

The sensor will continue to provide an output up to a pre-determined percentage of the full scale value; at this point the reading is clamped, regardless of any further increase in detected gas level. The over-range value should be specified when ordering; choose from the following values 100%, 125%, 150% and 200% The linearity of the output is only guaranteed up to the full scale for the sensor; the over-range condition for the host instrument should therefore be determined by the user.

## Sensor fault indication

The sensor constantly performs checks on the internal memory contents, the incoming supply voltage and the analogue signal values. These checks are used to ensure that the sensor is operating within its correct parameters, and that no internal faults have developed.

If a fault condition is detected, the output reading is set to the -250% full scale value.

## Digital interface

The digital communication pins “RX” and “TX” operate at a 2.8V logic level. When interfacing to external circuitry that uses a higher voltage level it is necessary to limit the current that can flow. The external voltage level should be 5V maximum and a 3K3 resistor should be used in series with each communication pin.

The Rx and Tx voltage limits are as follows:

RX - VIH: Input ‘High’ minimum voltage -  $0.8 V_{DD} = 2.24V$

RX - VIL: Input ‘Low’ maximum voltage -  $0.2 V_{DD} = 0.56V$

TX - VOH: Output ‘High’ minimum voltage -  $V_{DD} - 0.7 = 2.1$

TX - VOL: Output ‘Low’ maximum voltage -  $0.6V$

Refer to tds0045 Communication Protocol for further details.  
Contact Dynament Ltd. to obtain the document.

## Known Bugs (SIL Only)

SIL1 ( firmware version 07.17.00U) certified sensors are not suitable for use with 4800 baud rate.




<b>CERTIFICATION DETAILS</b>		
<b>European ATEX Certification</b>	<b>Sensor types MSH2-LP, MSH2-LS</b>	<b>Sensor types MSH2ia-LP, MSH2ia-LS</b>
<b>Approval body</b>	<b>FTZU</b>	<b>FTZU</b>
<b>Certificate Number</b>	<b>FTZU 14 ATEX 0213U (See footnote 2)</b>	<b>FTZU 14 ATEX 0213U (See footnote 2)</b>
<b>Test Standards</b>	<b>EN 60079-0:2012+A11:2013 EN 60079-1:2014 EN 60079-11:2012 EN 50303:2000</b>	<b>EN 60079-0:2012+A11:2013 EN 60079-1:2014 EN 60079-11:2012 EN 50303:2000</b>
<b>Certification Codes</b>	<b>I M2 Ex db I Mb II 2 G Ex db IIC Gb</b>	<b>I M1 Ex db ia I Ma II 2 G Ex db IIC Gb</b>
<b>Input parameters</b>	<b>0.8W max, 30V max. (See footnote)</b>	<b>Ui=6V dc, Pi=0.8W (See footnote)</b>
<b>Operating temperature</b>	<b>-20°C to +60°C (See footnote 1)</b>	
<b>International IECEx Certification</b>	<b>Sensor types MSH2-LP, MSH2-LS</b>	<b>Sensor types MSH2ia-LP, MSH2ia-LS</b>
<b>Approval body</b>	<b>FTZU</b>	<b>FTZU</b>
<b>Certificate Number</b>	<b>IECEX FTZU 15.0002U (See footnote 2)</b>	<b>IECEX FTZU 15.0002U (See footnote 2)</b>
<b>Test Standards</b>	<b>IEC60079-0:2011, Edition 6 IEC60079-1:2007-04, Edition 6</b>	<b>IEC60079-0:2011, Edition 6 IEC60079-1:2007-04, Edition 6 IEC60079-11:2011, Edition 6</b>
<b>Certification Codes</b>	<b>Ex d I Mb Ex db IIC Gb</b>	<b>Ex d ia I Ma Ex db IIC Gb</b>
<b>Input parameters</b>	<b>0.8W max, 30V max.</b>	<b>Ui=6V dc, Pi=0.8W</b>
<b>Operating temperature</b>	<b>-20°C to +60°C (See footnote 1)</b>	
<b>North American Certification</b>	<b>Sensor type MSH2-LP</b>	<b>Sensor type MSH2ia-LP</b>
<b>Approval body</b>	<b>Underwriters Laboratory Inc.</b>	<b>Underwriters Laboratory Inc.</b>
<b>File Reference</b>	<b>E336365</b>	<b>E336365</b>
<b>Test Standards</b>	<b>UL 60079 – 0, 4<sup>th</sup> Edition UL 60079 - 1, 6<sup>th</sup> Edition CAN/CSA-C22.2 No. 60079-0-1-7 CAN/CSA-C22.2 No. 60079-1 part 1, 1<sup>st</sup> Edition</b>	<b>UL913 7<sup>th</sup>, Edition UL 60079 – 0, 4<sup>th</sup>, Edition UL 60079 – 11, 2<sup>nd</sup>, Edition CAN/CSA-C22.2 No. 157-92</b>
<b>Hazardous Locations</b>	<b>Class 1, Zone 1, AEx d IIC and Ex d IIC Hazardous Locations</b>	<b>Class I, II, III, Division 1 Class 1, Zone 0, AEx ia IIC, T4 with 60°C ambient</b>
<b>Input/Entity parameters</b>	<b>0.8W max, 30V max.</b>	<b>Ui=6V dc, Pi=0.8W, Ci=4.105µF, Li=0 mH</b>
<b>Note1 Input parameters are defined for certification purposes only, refer to the “Specification” table for the sensor operating voltage and temperature range.</b>		
<b>Note 2 SIL Certificate number for all variants is SIRA FSP 14002/01</b>		

## GENERAL SPECIFICATION

<b>Operating Voltage Range:</b>	3.0 – 5.0 V d.c.
<b>Operating Current:</b>	Average current 15mA. See graph on page 7
<b>Operating temperature range:</b>	-20°C to +50°C (-4°F to 122°F)
<b>Warm up time:</b>	To final zero $\pm$ 2% full scale : Approximately 1 minute @ 20°C (68°F) ambient, some sensors may take longer
<b>Storage temperature range:</b>	-20°C to +50°C (-4°F to 122°F)
<b>Humidity range:</b>	0 to 95% RH non-condensing.
<b>Digital signal format:</b>	8 data bits, 1 stop bit, no parity. 2.8V logic level
<b>Standard baud rates:</b>	38,400, 19,200, 9600, 4800
<b>User configurable parameters:</b>	Full-scale value, resolution, Sensor 'zero' function Sensor 'span' function
<b>MTBF:</b>	> 5 years
<b>Weight:</b>	15 grams
<b>Pressure</b>	Accuracy limits are maintained at pressures within $\pm$ 5% of the calibration pressure.
<b>User configurable parameters and functions:</b>	Sensor 'zero' function Sensor 'span' function Over-range value

## MECHANICAL DETAIL

### NOTES

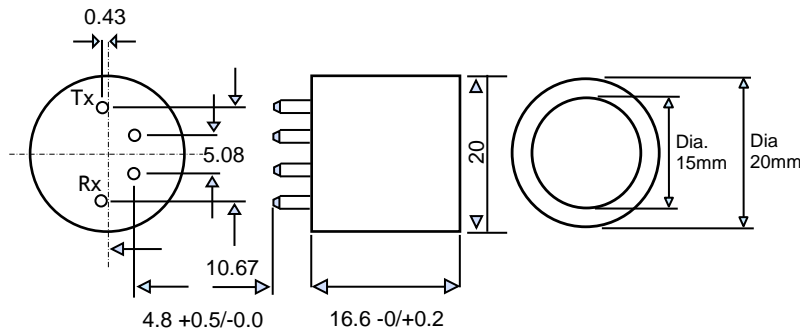

1. TOLERANCE: +/- 0.15 UNLESS OTHERWISE STATED.
2. RECOMMENDED PCB SOCKET  
WEARNES CAMBION LTD  
CODE: 450-3326-01-06-00.
3. **USE ANTI-STATIC PRECAUTIONS WHEN HANDLING**
4. **DO NOT CUT PINS**
5. **DO NOT SOLDER DIRECTLY TO PINS**
6. THE LABELLING ADDS UP TO 0.2 TO THE OUTER DIAMETER, AND UP TO 0.2 TO THE OVERALL HEIGHT

**All dimensions are in millimetres.** Pins viewed from underside  
 Diameter of pins = 1.5 +/- 0.05  
 Tx & Rx communication connections are available as either pads or pins

## HYDROCARBON CHANNEL SPECIFICATION @ 20°C (68°F) ambient

<b>Methane measuring range:</b>	0-5%, 0-100% volume or both
<b>Propane measuring range:</b>	0-2% volume
<b>Resolution:</b>	0.01% for readings up to 5% volume methane 0.1% for readings from 5% up to 100% volume methane For a full range of 0-5-100%, 0.01% between 0-5%, 0.1% between 5-100% 0.01% propane for all readings
<b>Linearity:</b>	The output is linear within $\pm 10\%$ of the applied gas, or $\pm 0.05\%$ volume, whichever is greater.
<b>Accuracy:</b> At 20°C, 1 bar atmospheric pressure, calibration gas applied	$\pm 2\%$
<b>Response Time T<sub>90</sub>:</b>	<30s
<b>Zero Repeatability:</b>	$\pm 0.05\%$ volume methane, $\pm 0.03\%$ volume propane
<b>Span Repeatability:</b>	$\pm 0.1\%$ volume methane at 5% applied gas. $\pm 2\%$ volume methane at 100% applied gas. $\pm 0.06\%$ volume propane at 2% applied gas.
<b>Long term zero drift:</b>	$\pm 0.05\%$ volume methane per month $\pm 0.03\%$ volume propane per month
<b>Temperature performance:</b> * May not be applicable when using gas cross-reference factors	$\pm 0.1\%$ volume or $\pm 10\%$ of reading up to 50% of full scale, $\pm 15\%$ of reading from 50% to 100% of full scale, or 2% of full scale whichever is greater over the range -20°C to +50°C (-4°F to 122°F)

## CARBON DIOXIDE CHANNEL SPECIFICATION @ 20°C (68°F) ambient

<b>Measuring ranges:</b>	0-10% volume up to 0-100% volume
<b>Resolution:</b>	0.1% for all readings
<b>Accuracy:</b> At 20°C, 1 bar atmospheric pressure, calibration gas applied	$\pm 2\%$
<b>Linearity:</b>	The linearity at ambient temperature is $\pm 3\%$ full scale or $\pm 10\%$ of the reading up to 80% full scale and $\pm 15\%$ of the reading from 80% to 100% full scale, whichever is greater.
<b>Response Time T<sub>90</sub>:</b>	<30s
<b>Zero Repeatability:</b>	$\pm 2\%$ of full scale
<b>Span Repeatability:</b>	$\pm 2\%$ of full scale
<b>Long term zero drift:</b>	$\pm 1\%$ of full scale / month
<b>Operating temperature range:</b>	-20°C to +50°C (-4°F to 122°F)
<b>Temperature performance:</b>	$\pm 10\%$ of reading up to 50% of full scale and $\pm 15\%$ of reading from 50% to 100% of full scale over the range -20°C to +50°C (-4°F to 122°F)

## Warranty information

All Dynament Platinum sensors carry a five-year warranty against defects in materials and workmanship. The warranty is invalidated if the sensors are used under conditions other than those specified in this data sheet.

Attention should be paid to the following criteria:

- **Observe the correct supply polarity**
- **Do not exceed the maximum rated supply voltage of 5V**
- **Do not solder directly to the sensor pins**
- **Do not expose the sensor to corrosive gases such as hydrogen sulphide**
- **Do not allow condensation to take place within the sensor**

Dynament reserve the right to alter technical specifications, without prior notice, when it is appropriate to implement a technical enhancement that leads to improved performance. Should any changes be required that could affect the customer's use of the product, Dynament will endeavour to contact customers directly to inform them of the changes.

## Ordering Details

In order to completely specify the type of sensor that is required, the customer needs to provide the following information (more information available on TDS0052 Platinum Sensor Ordering Codes): -

- An Order Code (see below) that specifies the sensors' basic physical and electrical characteristics.
- The sensor configuration requirements, including the required gas measurement ranges.

**EXAMPLE OF ORDER CODES**

**MSH2 – LD / HC / HCO2 / P / F**

↑

↑

↑

↑

↑

↑

Option

**FILTER :** BLANK = OMITTED  
F = FITTED

**SUPPLY POLARITY :**  
P = Positive

**GAS TYPES :**  
HC = Hydrocarbon  
HCO2 = High Range Carbon dioxide


**LOW POWER DUAL SENSOR**  
LD = Non SIL  
LS = SIL1

**TYPE MSH2 or MSH2ia (For Mining M1 applications only)**

**CONFIGURATION OPTIONS**  
(To be stated on customer order in addition to the Order Code)

1. Communication speed – 38,400 baud (default), specify alternative rate if required.
2. Over-range value: 100%, 125%, 150% and 200% of full-scale value.

## Dual Premier Pin-Out



**Dual Premier Positive  
Polarity**